




Connecting Strength

The South Face UL 3741 PV Hazard Control



INSTALLATION ADDENDUM

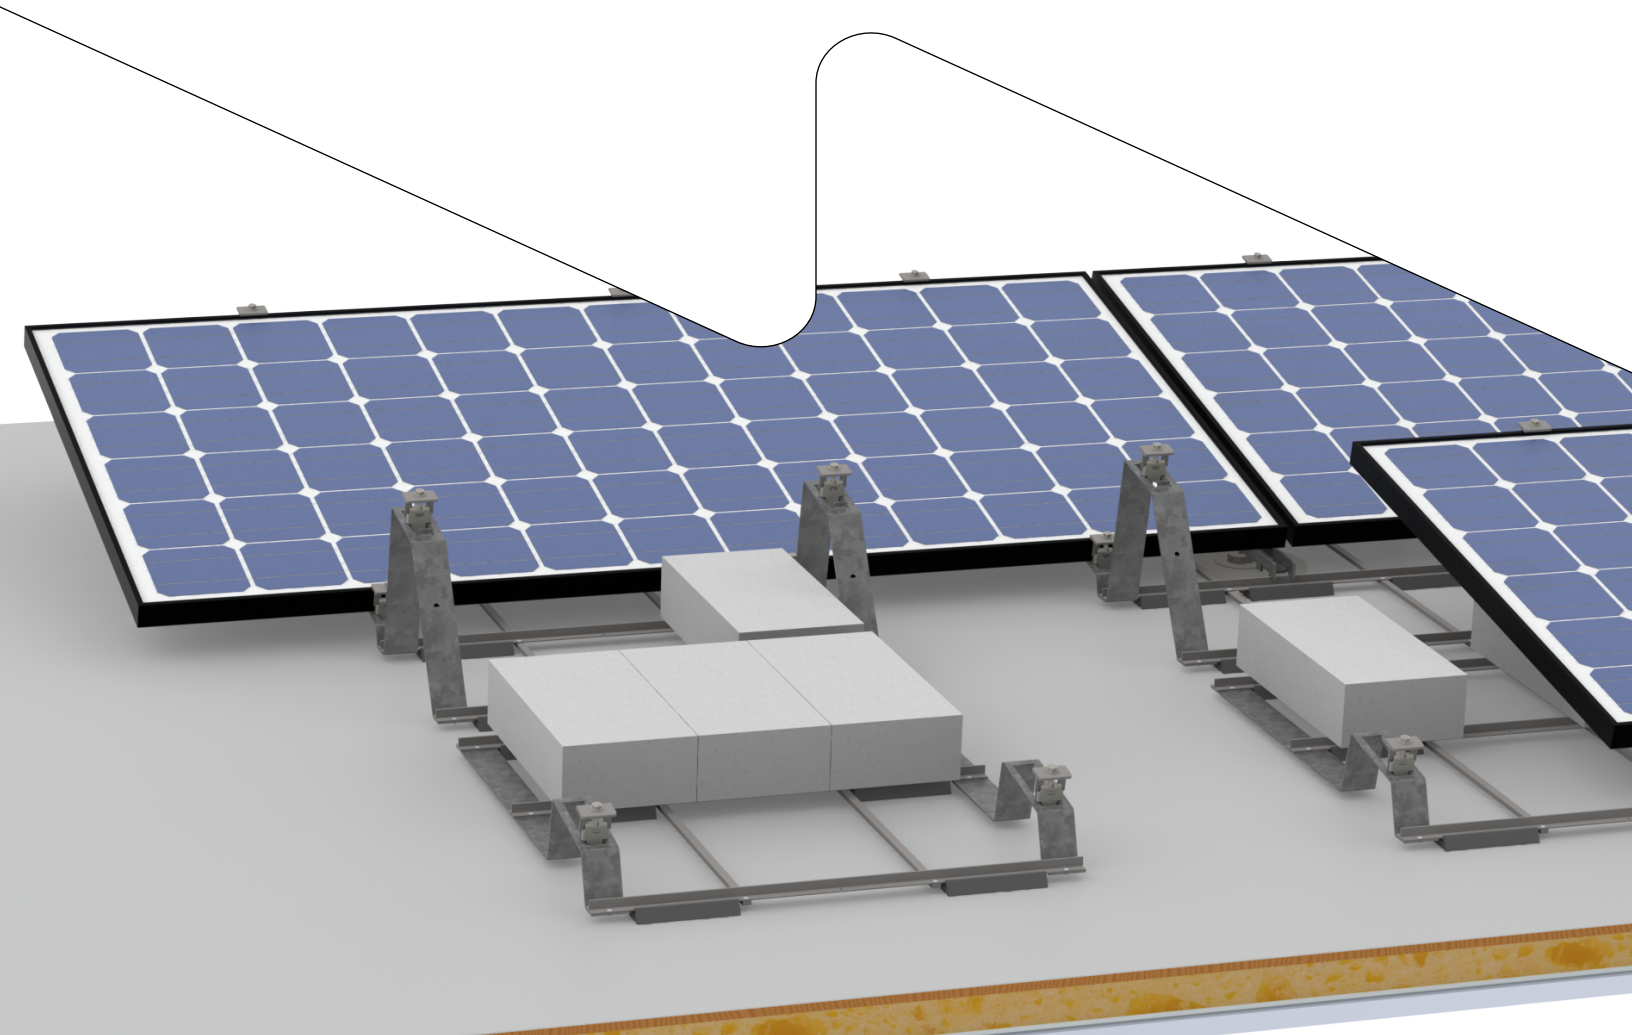



Content

• Disclaimer	3
• Ratings	4
• Markings	5
• Approved Electrical Equipment	7
• Introduction: Understanding UL 3741 and NEC 690.12	12
• Installation Methods	13
• Case 1	14
• Case 2	15
• Case 3	16
• Case 4	17
• UL 3741 Wire Management Guidelines	18
• Notes	22

Engineering strength is at our core

With sophisticated product innovations and a deep customer focus, K2 Systems is the engineering leader for all your mounting system needs. We are a market leader with more than 32 GW installed worldwide.

We offer proven product solutions and innovative designs. Wind tunnel testing along with advanced structural and electrical validation to facilitate permitting, design and installation. Our designs result in cost competitive racking systems with dedicated support that will position you to win more projects.

We partner with our customers and suppliers for the long-term. High quality materials and cutting edge designs provide a durable, yet functional system. Our product line is comprised of a few, coordinated components that lower the cost of materials, and simplify installation, saving you time and money. All backed by German engineering, a long track record of quality and a company that is here to stay.

Thank you for choosing K2 Systems for your Solar PV Project.

Quality tested – several certifications

K2 Systems stands for secure connections, highest quality and precision. Our customers and business partners have known that for a long time. Independent institutes have tested, confirmed and certified our capabilities and components.

Please find our quality and product certificates under:
<https://k2-systems.com/en-us/company/quality-management/>

Disclaimer



This manual describes proper installation procedures and provides the necessary standards required for product reliability. Warranty details are available at k2-systems.com/en-us. All installers must thoroughly read this manual and have a clear understanding of the installation procedures prior to installation. Failure to follow these guidelines may result in property damage, bodily injury or even death

INSTALLER'S RESPONSIBILITY:

- Ensure safe installation of all electrical aspects of the array. All electrical installation and procedures should be conducted by a licensed and bonded electrician or solar contractor. Routine maintenance of a module or panel shall not involve breaking or disturbing the bonding path of the system. All work must comply with national, state and local installation procedures, product and safety standards.
- Comply with all applicable local or national building and fire codes, including any that may supersede this manual.
- Ensure all products are appropriate for the installation, environment, and array under the site's loading conditions.
- Use only K2 Systems parts or parts recommended by K2 Systems; substituting parts may void any applicable warranty.
- If needed, use K2 System's design tool, Base, to obtain accurate system design prior to installation.
- Ensure provided information is accurate. Issues resulting from inaccurate information are the installer's responsibility.
- Ensure bare copper grounding wire does not contact aluminum and zinc-plated steel components, to prevent risk of galvanic corrosion.
- Refer to components list and respective manufacturers for best practices on inspection frequency. K2 Systems recommends annual inspection. If loose components or loose fasteners are found during periodic inspection, re-tighten immediately. Any components showing signs of corrosion or damage that compromise safety shall be replaced immediately.
- Provide an appropriate method of direct-to-earth grounding according to the latest edition of the National Electrical Code, including NEC 250: Grounding and Bonding, and NEC 690: Solar Photovoltaic Systems.
- Disconnect AC power before servicing or removing modules, microinverters and power optimizers.
- Review module manufacturer's documentation for compatibility and compliance with warranty terms and conditions.
- Installers shall refer to the South Face assembly instructions for complete installation instructions.
- Review all third-party equipment installation manuals for specific instructions such as installation configurations, mounting, Clearances, compatible connectors, and rapid shutdown initiation methods.
- Ensure that the roof is in good condition prior to installing any K2 System's components.

CAUTION: Module removal may disrupt the bonding path and could introduce the risk of electric shock. If during servicing a module is required to be removed, a bonding jumper shall be installed between the adjacent modules from where the module was removed to maintain the bond path.

WARNING: To reduce the risk of injury, read all instructions.

Ratings

UL 2703 LISTED
UL 3741 LISTED



#5031193

Intertek



CONFORMS TO STD ANSI/UL 3741 STANDARD FOR SAFETY PHOTOVOLTAIC HAZARD CONTROL SYSTEM

Max PVHCS System Voltage: 1000V

Model Type 1 or Type 2

South Face List of Approved PV Hazard Control Equipment or Components evaluated at 1000V Max System Voltage: (Not all listed items must be implemented in a single system to achieve compliance to UL 3741. Rather these are the items approved for use to meet the criteria outlined in this manual).

- All Modules listed in the Approved Modules section of the South Face Assembly Instructions
- The South Face System
- South Face Accessories
 - MLPE Module Frame Mount Kit (4000083)
 - SF UL 3741 Plate, Kit (4000390)
 - SF UL 3741 Rapid Shutdown, Sticker (7000465)
 - SF UL 3741 MLPE Shutdown, Sticker (7000466)
- PV Wire (UL 4703 Listed) and PV Connectors (UL 6703 Listed) shall be compatible and approved for the application.
- Wire Clips
 - Hellermann Tyton Edge Clip and Cable Ties (PNs CTT60R-PA66HS, T50REC5B-PA66HS & T50REC5A-PA66HS) (UL 62275 Listed)
 - Heyco SunRunner (UL 1665)
 - Heyco SunRunner Short Flange Bi-Directional(UL 1665)
 - Burdny (Wiley) Cable Clips (Models ACC-FPV, ACC-FPV180 and ACC-F90-1)
 - K2 Dragon Clip
- RayTray v2 Solar Wire Management System (UL 870 Listed)
- Listed Conduit (all sizes apply)
 - Electrical Metallic Tubing (EMT), size 3/4" or greater (UL 797 Listed)
 - Rigid Metal Conduit (RMC), size 3/4" or greater (UL 6 Listed)
 - Intermediate Metal Conduit (IMC), size 3/4" or greater (UL 1242 Listed)
 - Liquid-Tight Flexible Nonmetallic Conduit, size 3/4" or greater (UL 1660 Listed)
 - Liquid-Tight Flexible Metal Conduit, size 3/4" or greater (UL 360 Listed)
 - PVC Schedule 40 or 80, size 3/4" or greater (UL 651 Listed)
 - Bonding Bushings, size 3/4" to 1-1/2" (UL 467 Listed)
 - Various Listed Conduit, Connectors and Fittings

Please see page 7 for list of UL 3741 approved electrical equipment.


Markings




Verify that the system is labeled at each service equipment location to which the PV system is connected or at an approved readily visible location outside the array boundary. Attach one label at or near the Rapid Shutdown Switch. Labels are provided by K2 Systems within the UL 3741 Labeling Kit.

A separate label was designed for systems that utilize MLPEs. Where MLPEs are used to control circuits within subarrays, make sure to install the correct label for the system. Please refer to the sample labels in the next page to distinguish between the two.

“Rapid Shutdown Switch” refers to the AC disconnect, breaker, and/or isolation devices used as initiation devices for the system.

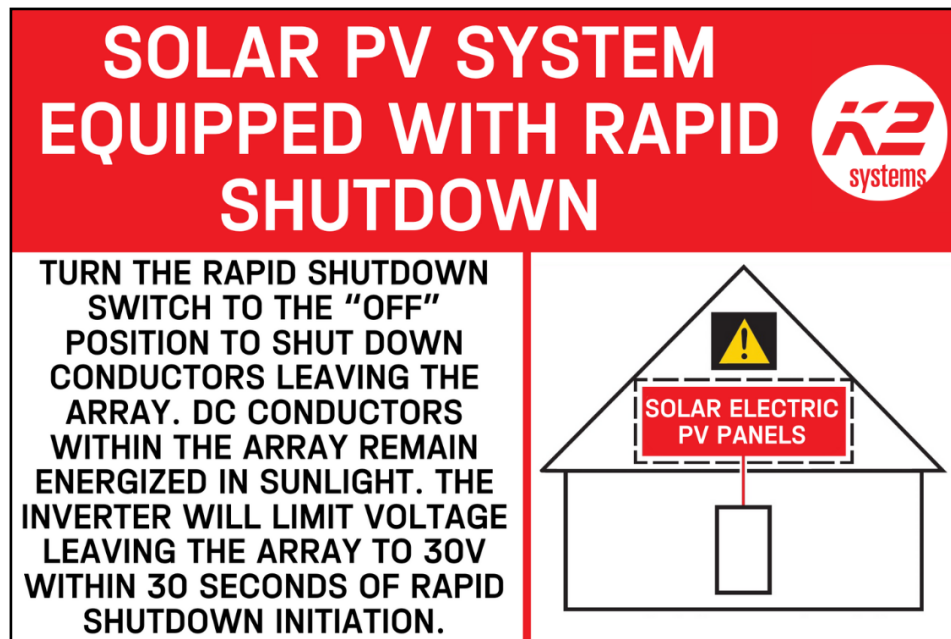

Rapid Shutdown Switch Label, no MLPEs used.

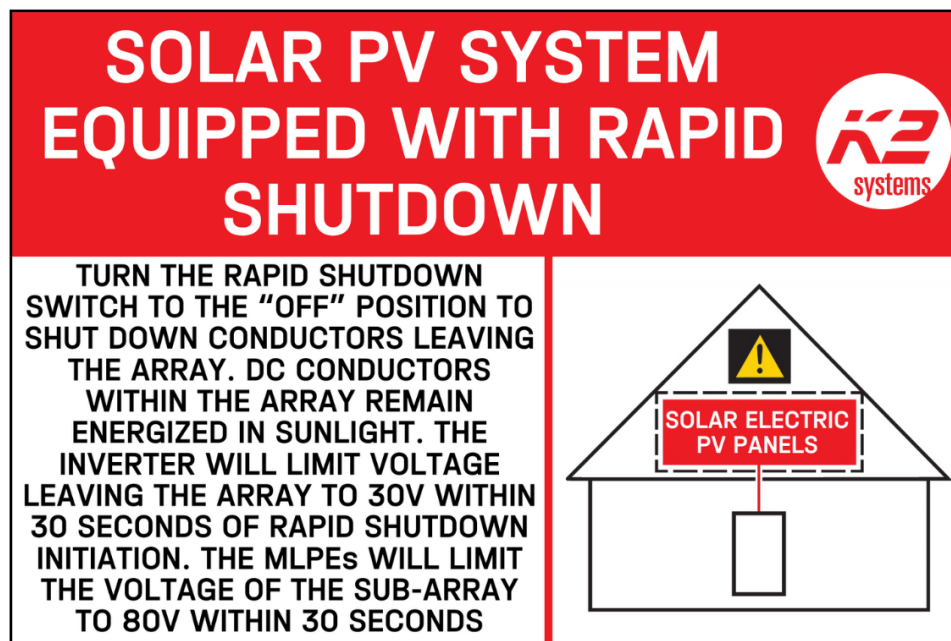


Rapid Shutdown Switch Label, for systems with MLPEs.

Markings





The UL 3741 marking is visible on the K2 Systems nameplate, which is to be installed at the end chassis. The nameplate must be installed at the northernmost row by eastern most chassis (as denoted by the red circle):

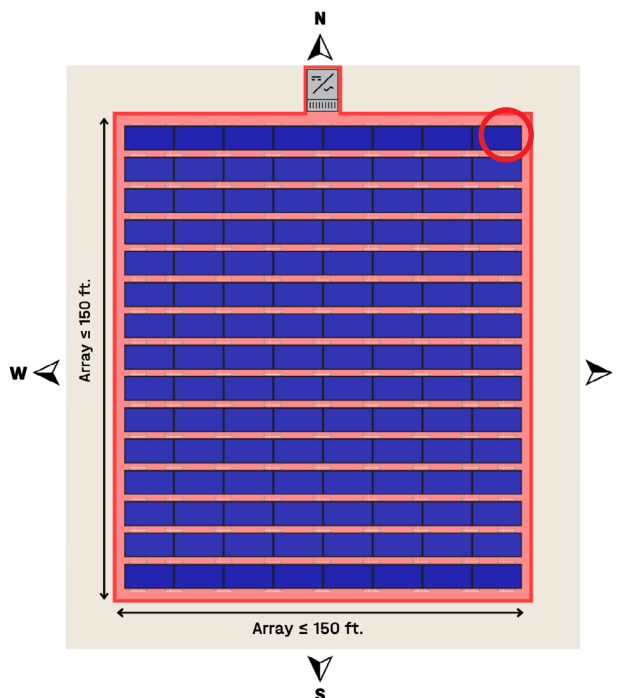

Installation:

- Align the hole of the UL 3741 nameplate to the accessory hole of the South Face Ridge or Summit chassis (The accessory hole is located above the K2 Systems logo on the back leg)
- Connect the nameplate to the chassis using the Serrated Hex Head M8×20 Bolt and Serrated Head Flange Nut within the kit
- Tighten the bolt to a torque of 12 ft-lbs
- Ensure that the writing faces outward and is legible

NOTE: THE UL 3741 NAMEPLATE IS PROVIDED WITHIN THE SF UL 3741 PLATE, KIT.

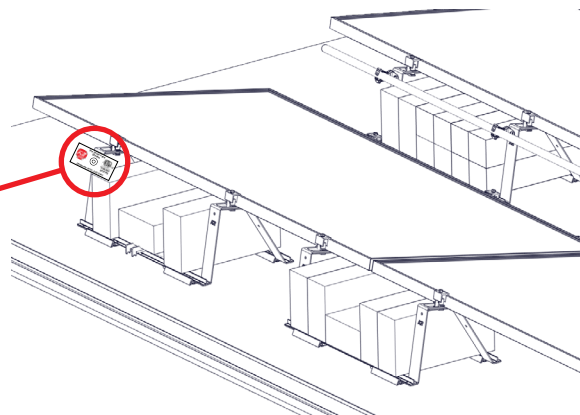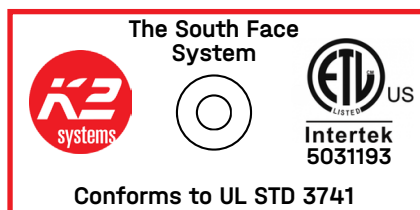

Approved Electrical Equipment (UL 1741 Listed)



INVERTERS:

• Canadian Solar (CSI Solar) Inverters

- CSI-75K-T480GL02-U
- CSI-80K-T480GL02-U
- CSI-90K-T480GL02-U
- CSI-100K-T480GL02-U
- CSI-75K-T480GL03-U
- CSI-80K-T480GL03-U
- CSI-90K-T480GL03-U
- CSI-100K-T480GL03-U
- CSI-30KTL-GS-FLB
- CSI-40KTL-GS-FLB
- CSI-40KTL-GS-B
- CSI-60KTL-GS-B
- CSI-25K-T480GL01-UB
- CSI-30K-T480GL01-UB
- CSI-36K-T480GL01-UB
- CSI-40K-T480GL01-UB
- CSI-50K-T480GL01-UB
- CSI-60K-T480GL01-UB
- CSI-66K-T480GL01-UB

• Chint Inverters

- CPS SCA25KTL-DO/US-208
- CPS SCA25KTL-DO-R/US-480
- CPS SCA36KTL-DO/US-480
- CPS SCA50KTL-DO/US-480
- CPS SCA60KTL-DO/US-480

• Fronius Inverters

- Fronius Symo Advanced 10.0-3 208-240/Lite
- Fronius Symo Advanced 12.0-3 208-240/Lite
- Fronius Symo Advanced 15.0-3 480/Lite
- Fronius Symo Advanced 20.0-3 480/Lite
- Fronius Symo Advanced 22.7-3 480/Lite
- Fronius Symo Advanced 24.0-3 480/Lite

• GoodWe Inverters

- GW50K-SMT-US
- GW60K-SMT-US
- GW6000-MS-US30
- GW6000A-MS
- GW7600-MS-US30
- GW7600A-MS
- GW8600A-MS
- GW9600-MS-US30
- GW9600A-MS

• NEP (Northern Electric Power Technology) Inverters

- Neptune30K
- Neptune30K-LV
- Neptune33K
- Neptune50K
- Neptune75K
- Neptune100K

• SMA Solar Technology Inverters

- STP 50-US-40
- STP 33-US-41
- STP 50-US-41
- STP 62-US-41
- STP 20-US-50
- STP 25-US-50
- STP 30-US-50

• Solectria Renewables Inverters

- PVI 25TL-208
- PVI 25TL-480-R
- PVI 36TL-480-V2
- PVI 50TL-480
- PVI 60TL-480

• Solis (Ginlong Technologies) Inverters

- Solis-25K-US-SW
- Solis-25K-US-F-SW
- Solis-25K-US-LSW
- Solis-30K-US-SW
- Solis-30K-US-F-SW
- Solis-30K-US-LSW
- Solis-36K-US-SW
- Solis-36K-US-F-SW
- Solis-36K-US-LSW
- Solis-40K-US-SW
- Solis-40K-US-F-SW
- Solis-40K-US-LSW
- Solis-50K-US-SW
- Solis-50K-US-F-SW
- Solis-50K-US-LSW
- Solis-60K-US-F-SW
- Solis-60K-US-F-LSW
- Solis-66K-US-F-SW
- Solis-66K-US-F-LSW
- S5-GC75K-US
- S5-GC80K-US
- S5-GC90K-US
- S5-GC100K-US
- S5-GC125K-US
- S5-GC60K-LV-US

- S6-GC25K-US
- S6-GC30K-US
- S6-GC33K-US
- S6-GC36K-US
- S6-GC40K-US
- S6-GC50K-US
- S6-GC60K-US
- S6-GC30K-LV-US
- S6-EH1P3.8K-H-US
- S6-EH1P5K-H-US
- S6-EH1P7.6K-H-US
- S6-EH1P9.9K-H-US
- S6-EH1P10K-H-US
- S6-EH1P11.4K-H-US
- Solis-1P3.6K-4G-US
- Solis-1P5K-4G-US
- Solis-1P6K-4G-US
- Solis-1P7.6K-4G-US
- Solis-1P10K-4G-US
- S6-EHP2P9.5K03-SV-YD-L-US
- S6-EHP2P11.4K03-SV-YD-L-US
- S6-EHP2P14K03-SV-YD-L-US
- S6-EHP2P16K03-SV-YD-L-US

• Sungrow Inverters

- SG36CX-US
- SG60CX-US

Approved Electrical Equipment (UL 1741 Listed)



MLPE and PVRSS:

- **APsmart (Alternate Power System) (Rapid Shutdown Device)**

- RSD-S-PLC-A
- RSD-D-15-1000
- RSD-D-20-1000
- RSD-D-15-1500
- RSD-D-20-1500

• **Note:** Refer to manual for accessories and compatible power electronics for PVHCS compliance.

- **Benyi (Zhejiang Benyi New Energy) (Rapid Shutdown Device)**

- BFS-21
- BFS-22

- **IMO Precision Controls (Rapid Shutdown Device)**

- FRS-01
- FRS-02
- FRS-ESW1
- FRS-ESW2

- **NEP (Norther Electric Power Technology) (Rapid Shutdown Device)**

- PVG-1
- PVG-2
- PVG-3

• **Note:** Refer to manual for accessories and compatible power electronics for PVHCS compliance.

- **SMA (Zhejiang Jiaming Tianheyuan Photovoltaic Technology) (Rapid Shutdown Device)**

- JMS-F

• **Note:** Paired with approved SMA SunSpec certified inverters (SBxx-1SP-US-41, CORE1 STP-xx-US-41). Refer to manual for accessories and compatible power electronics for PVHCS compliance.

- **Tigo Energy (Rapid Shutdown Device)**

- Tigo Access point (TAP)150-10000-50 158-20000-00
- TS4-A-F
- TS4-A-2F
- TS4-A-O
- TS4-A-O-DUO
- TS4-A-S
- TS4-R-F
- TS4-R-O
- TS4-R-O-DUO
- TS4-R-S
- TS4-R-S-DUO
- TS4-X-F
- TS4-X-O
- TS4-X-S

• **Note:** Refer to manual for accessories and compatible power electronics for PVHCS compliance.

IMPORTANT: Refer to the applicable MLPE/Rapid Shut Down receiver and its listed Inverter's Installation Manuals for specific instructions, including mounting, clearances, ratings, compatible connectors, compatible transmitters, and rapid shutdown initiation methods for PVHCS compliance

Introduction: Understanding UL 3741 and NEC 690.12



UL 3741 and NEC Rapid Shutdown Compliance

The South Face Photovoltaic Hazard Control System (PVHCS) is a UL 3741 Listed system that provides compliance with the National Electrical Code's (NEC) Rapid Shutdown of PV Systems on Buildings, found in section 690.12. The PVHCS must be installed in accordance with the manufacturer's installation instructions utilizing the materials and methods listed in this addendum.

NEC 690.12 and South Face Compliance

NEC requires that specific PV circuits be controlled to reduce shock hazards to firefighter (FF) interactions. The code differentiates the requirements based on the circuit's location in relation to the array boundary. The array boundary is defined as one foot in all directions from the array. In a South Face System, the one-foot boundary extends from the edge of the PV modules or racking, whichever is exposed after installation.

NEC defines the array as a mechanically and electrically integrated grouping of modules with support structure, including any attached system components such as inverter(s) or dc-to-dc converter(s) and attached associated wiring.

Outside the Array Boundary

- NEC requires PV system circuit conductors to be reduced to $\leq 30V$ within 30 seconds within rapid shutdown initiation. The South Face PVHCS complies with this requirement through the use of listed inverters. For proper installation of the inverters, see their respective installation criteria and requirements.

Inside the Array Boundary

- NEC has multiple methods to meet requirements to control conductors within the array boundary. The South Face System has been tested to UL 3741 to provide proper protection from shock hazards imposed on FF by system components within the array boundary.
- The South Face listing includes the use of multiple isolation devices to control the PV system circuits. Refer to the installation instructions for the string isolation devices as well as this addendum to verify proper installation with the specific isolation device used.

Initiation Devices

- Initiation device(s) shall initiate the rapid shutdown function of the PV system.
- The South Face System utilizes initiation devices integrated with the Power Conversion Systems (inverters). Proper installation will include installing the inverters and any associated initiation devices as required.

Installation Methods per UL 3741 and NEC 690.12



The following case studies are provided by K2 Systems to show examples of installation configurations that comply with NEC 690.12, compliance is not limited to these examples.

Case 1: UL 3741 Listed System – See page 10

Case 2: UL 3741 Listed System with Contiguous Sub-Array – See page 11

Case 3: UL 3741 Listed System with MLPE Sub-Array – See page 12

The simplest installation method to comply with NEC690.12 is to utilize the South Face UL 3741 system with a contiguous array with one or more collocated inverters, as all inverter DC input circuits are within the 1ft array boundary can comply by using a single or combining one or more of the three options below (Cases 2-3).

Case studies and NEC guidance have not been verified by Intertek.

Case 1: UL 3741 Listed System




Array(s) comply with NEC 690.12

- Outside Array Boundary: $\leq 30V$ within 30 Seconds
- Inside Array Boundary: $\leq 1000V$

Array(s) complies with 690.12 by utilizing a listed UL 3741 PV Hazard Control System

- A:** All inverter input circuits (DC) are contained within the PV array boundary and do not require additional measures to reduce string voltages per 690.12 after initiation (Inverter DC disconnect, AC breaker or AC disconnect).
- B:** Inverter output circuits (AC) are outside of the array boundary and meet the 690.12 requirement after initiation (AC breaker or AC disconnect).

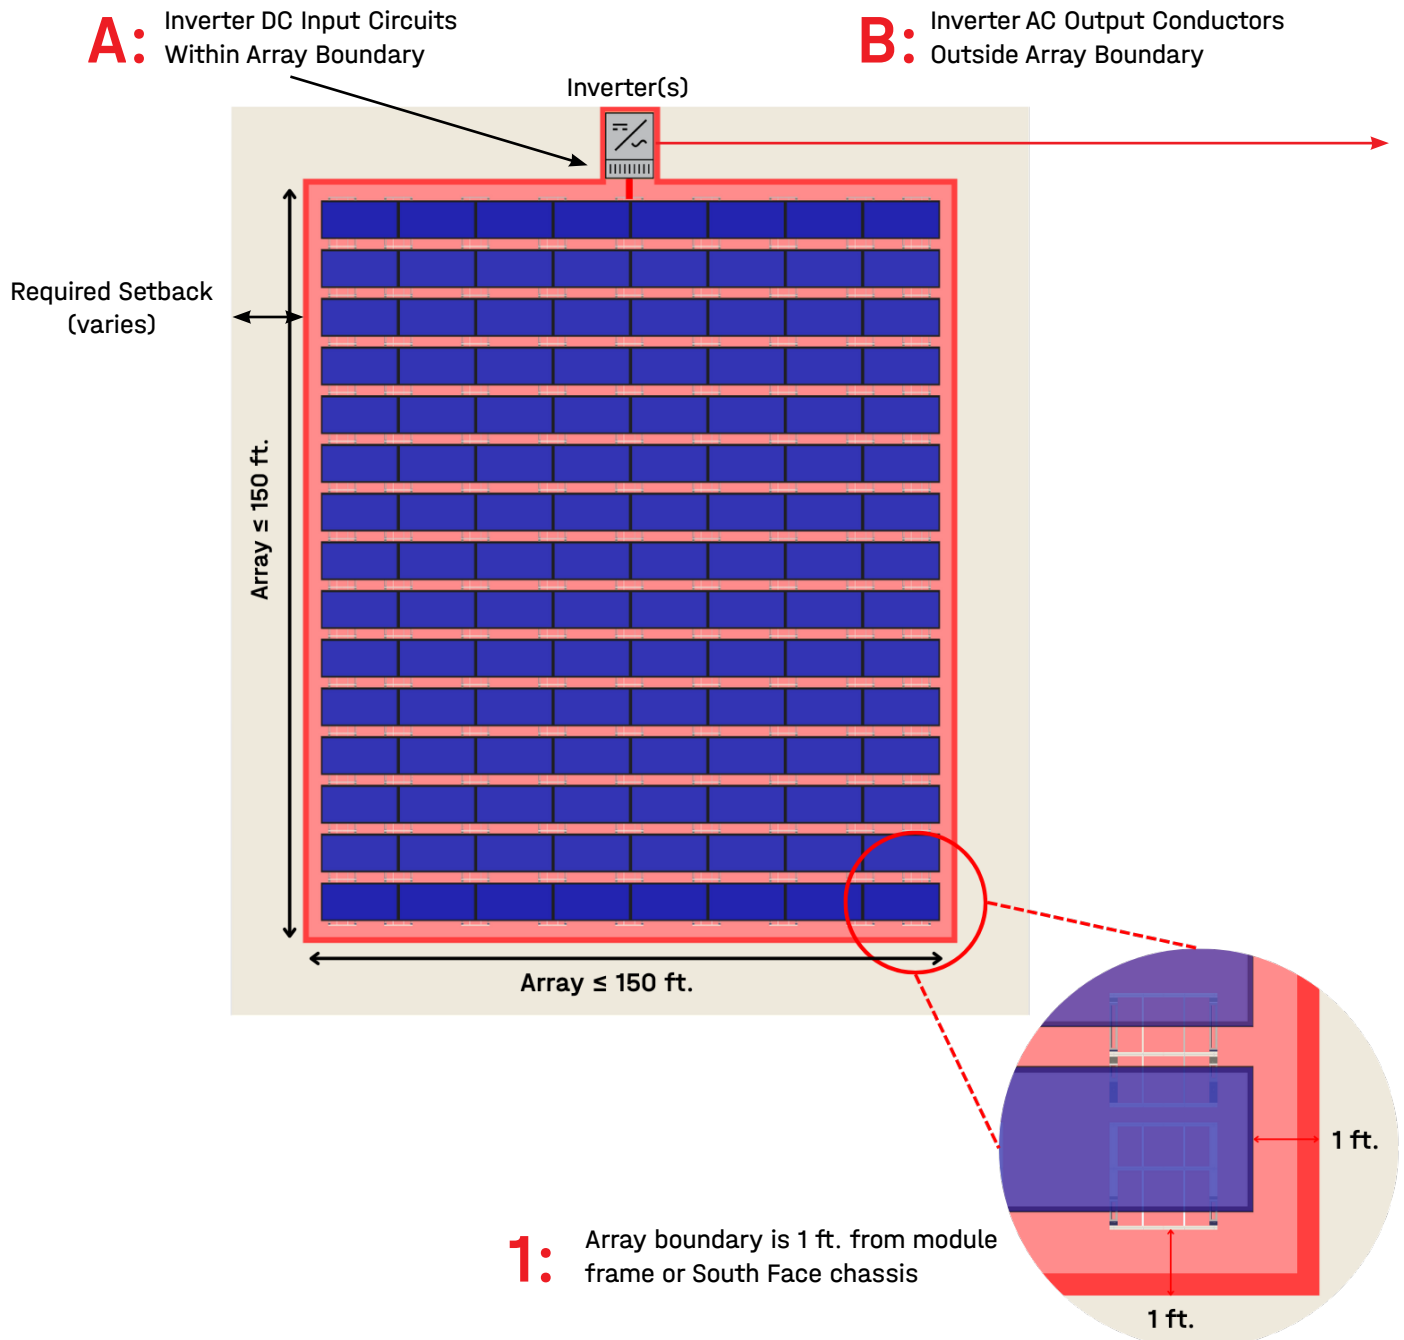

Case 2: UL 3741 Listed System with Contiguous Sub-Arrays


Sub-Arrays(s) are within the same Array Boundary and Array(s) comply with NEC 690.12

•Outside Array Boundary: $\leq 30V$ within 30 Seconds

•Inside Array Boundary: $\leq 1000V$

Maintaining NEC Compliance with sub-array(s) within array boundary

Maximum 2 ft. spacing between all array components resulting in a single array boundary.

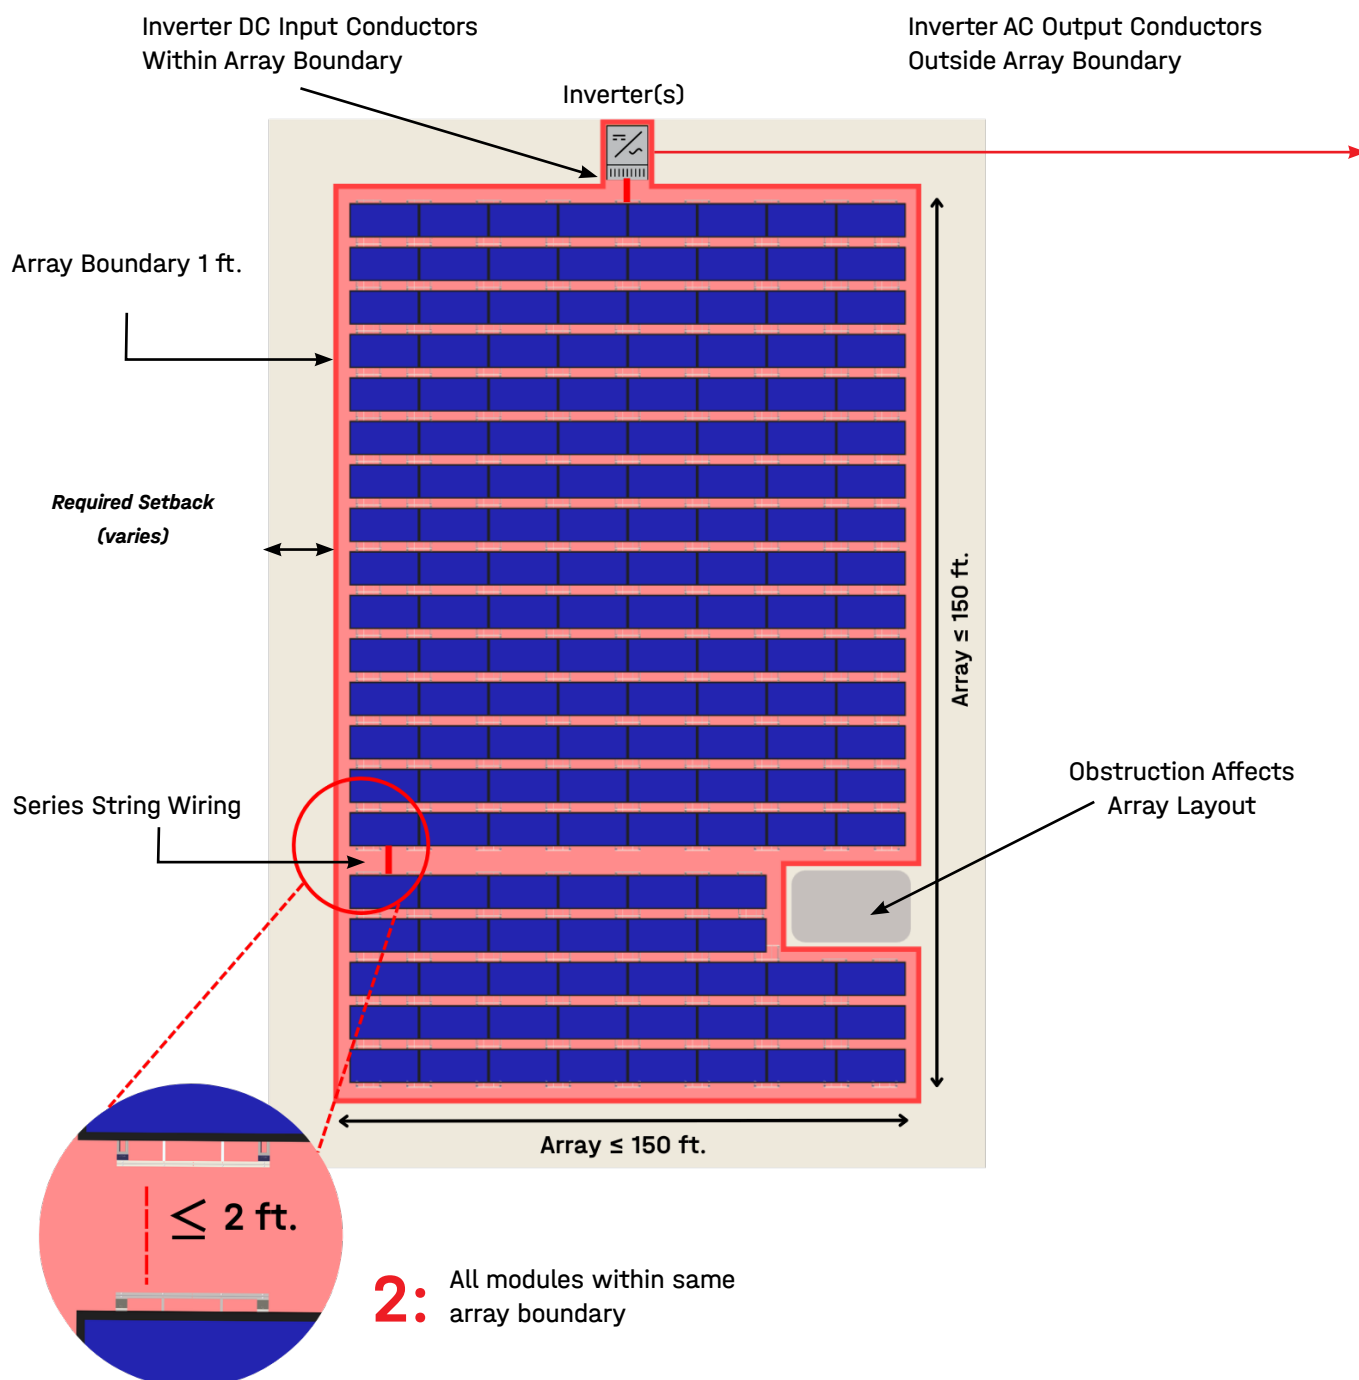


Case 3: South Face UL 3741 Listed System Multiple-Sub-Arrays

- Outside Array Boundary: $\leq 30V$ within 30 Seconds
- Inside Array Boundary: $\leq 1000V$

Maintaining NEC Compliance with sub-array(s) outside of array boundary

Complete string must be connected to a single isolation device. If used for a partial string, isolation devices required on both sides of the pathway since voltage will be present on both sides.

NOTE: Must place SID beneath module.

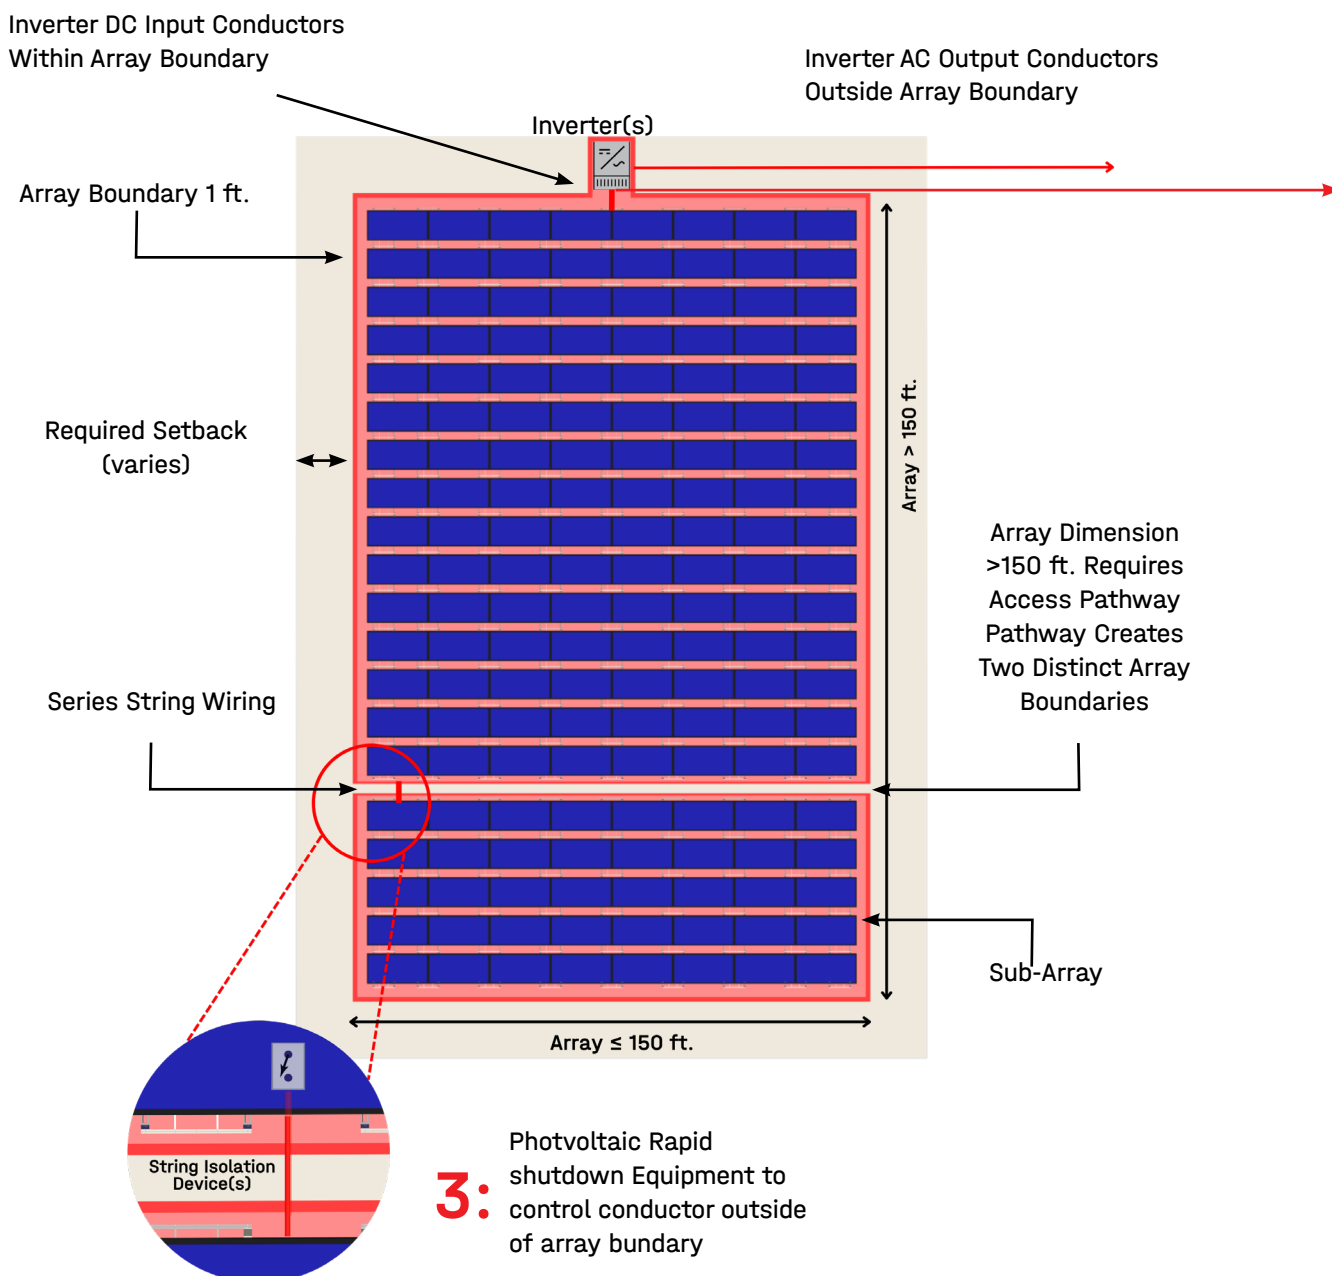

Case 4: South Face UL 3741 Listed System with MLPE Sub-Array


Sub-array(s) using MLPEs to control circuits for the 690.12 compliance

- Outside Array Boundary: $\leq 30V$ within 30 Seconds
- Inside Array Boundary: $\leq 1000V$
- Inside Sub-Array Boundary: $\leq 80V$ inside within 30 Seconds

Maintaining NEC Compliance with sub-array(s) outside of array boundary

Utilize Module-Level Power Electronics (MLPEs) on lower sub-array. All modules on the same inverter input must be connected to an MLPE. Upper array utilizes UL3741 listing without MLPEs for compliance.

NOTE: When using MLPE devices, review installation instructions for both the MLPE device and inverter to verify that both devices comply with UL1741 Rapid Shutdown requirements. If required for rapid shutdown functionality, install necessary transmitters outside the array boundary.

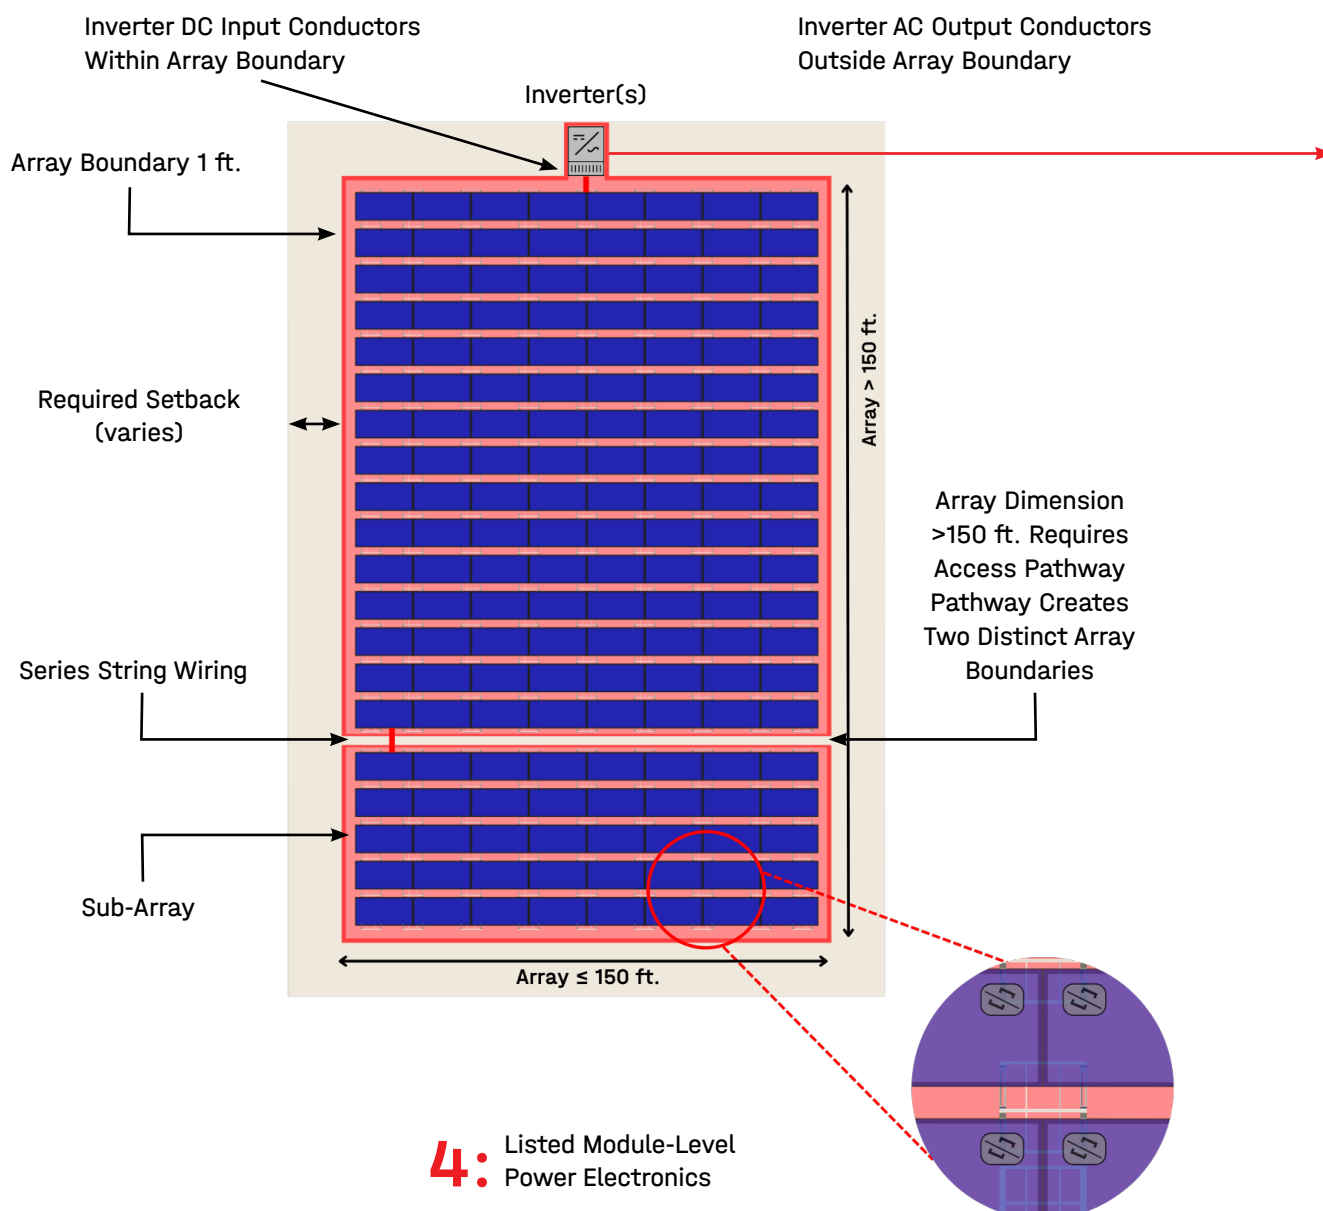

UL 3741 Wire Management Guidelines



The South Face Wire management components noted in the list of approved PVHCS equipment on page 2 were evaluated and approved for providing wire protection against potential FF interactions. To achieve wire protection as required per UL 3741, all wires shall be routed such that they are not exposed to potential FF interactions. This is achieved using the following methods:


Wire Clips:

- Route PV wires under the cover of modules using approved cable ties and clips
- Do not allow wires to sag between clips, with a minimum of one clip every 24 inches (per NEC 690.31)
- Do not over tighten or pinch wires
- Position clips to prevent contact between the wire and metallic components of the module and the racking system


Raceways

- Protect wires in exposed areas such as inter-row spaces and pathways by utilizing the listed raceways on page 2 (RayTray, conduit, etc.)
- Ensure that PV wire is not exposed to sharp edges when entering or exiting the raceway

See photos for examples of under module and under chassis wire management

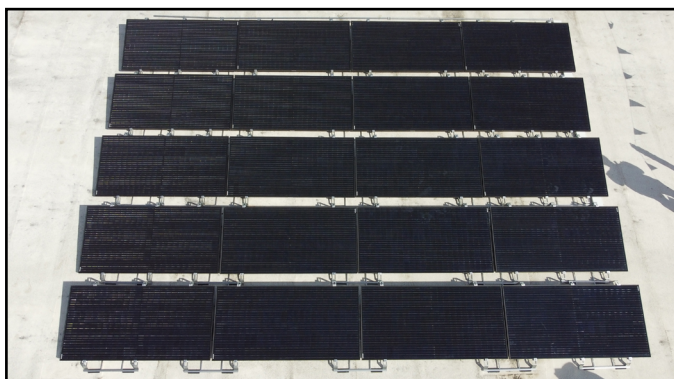


All wiring managed under module; required conduit, raceways, and cable ties are not shown in the example above.

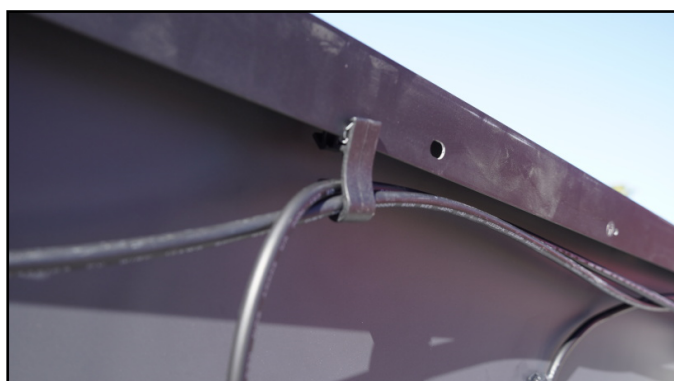

K2 Dragon Clip example of installation

IMPORTANT: Conductors leading to subarrays or other components, when not coverable by a module, shall be enclosed in approved electrical raceways like the Listed conduit types specified in page 4

UL 3741 Wire Management Guidelines

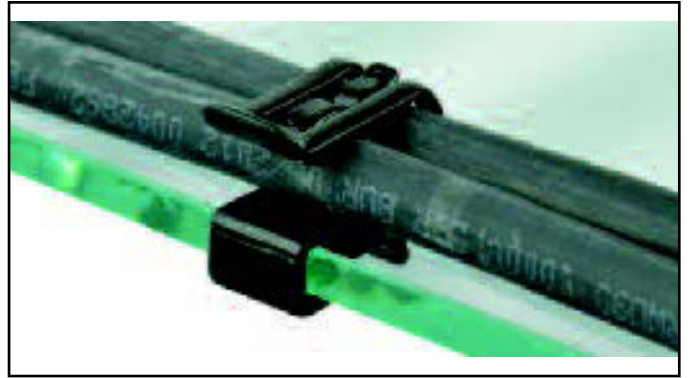

Heyco cable clips example of installation



Hellermann Tyton Edge Clip and Cable Ties example of installation



Wiley cable clips example of installation

IMPORTANT: Conductors leading to subarrays or other components, when not coverable by a module, shall be enclosed in approved electrical raceways like the Listed conduit types specified in page 4



UL 3741 Wire Management Guidelines





Manage larger bundles of cables using RayTray or another listed raceway. When entering and exiting the raceway, installers shall ensure PV wires are routed away from exposure to Fire Fighter interactions.



Examples of wire installation in RayTray.

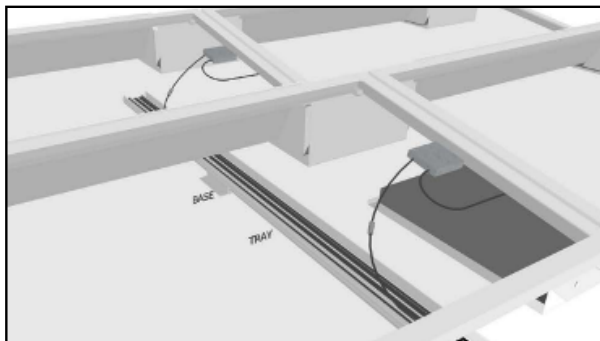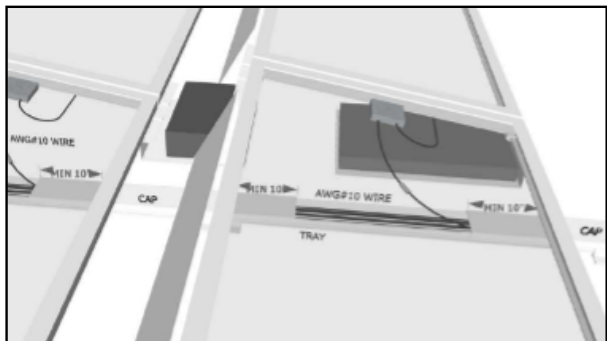

Examples of wire installation in RayTray underneath modules.

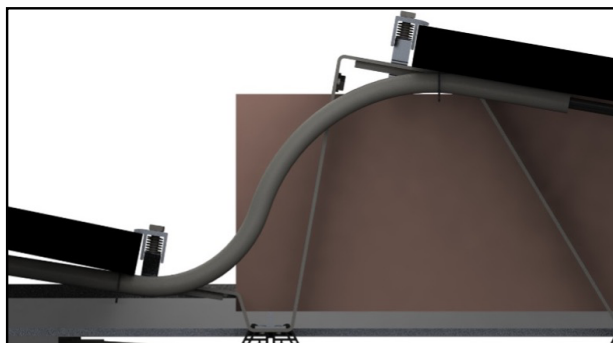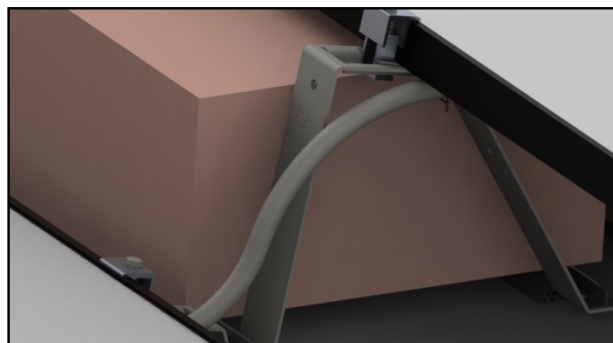

Examples of row-to-row wire installation through listed conduit.

IMPORTANT: Conductors leading to subarrays or other components, when not coverable by a module, shall be enclosed in approved electrical raceways like the Listed conduit types specified in page 4

Notes




Notes





Connecting Strength

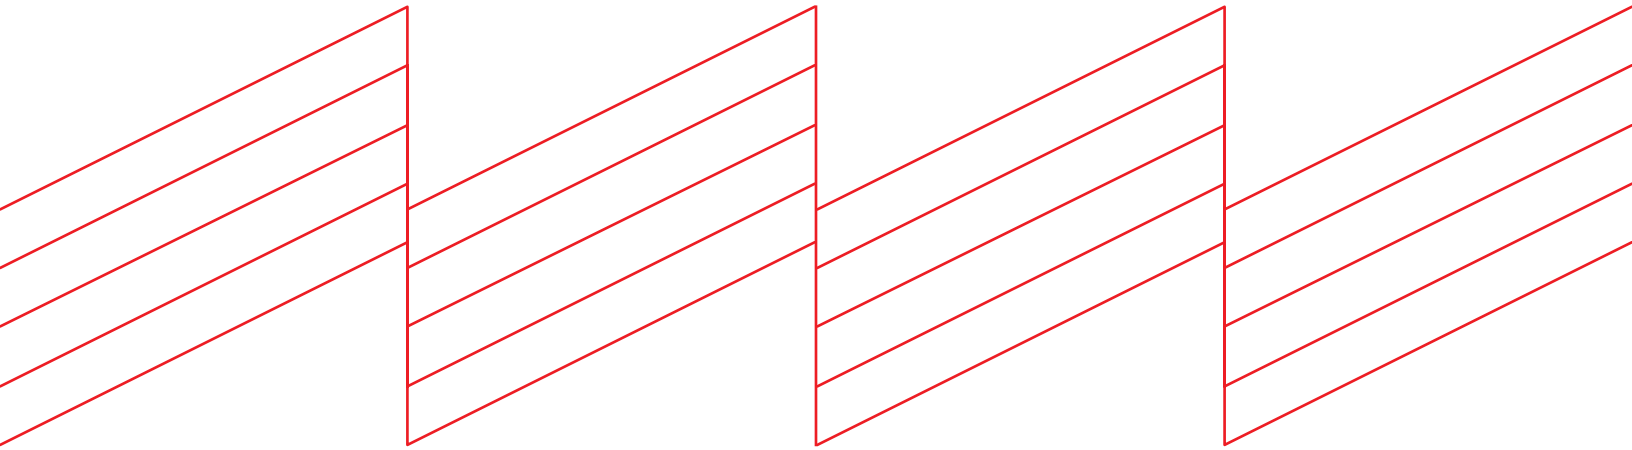

K2 Systems LLC

4665 North Ave. Suite I • Oceanside, CA 92056 •
USA +1.760.301.5300 • info@k2-systems.com
www.k2-systems.com/en-us

The South Face UL 3741 Addendum ENV2 | 0925 • Subject to change.
Product illustrations are exemplary and may differ from the original.

The South Face UL 3741 Addendum ENV2 | 0625 • Sujeta a cambios. Las
ilustraciones del producto son ejemplares y pueden diferir del original.